


LOWER GRANITE

ADULT

CAUTION
MORE THAN ONE SOURCE OF ENERGY PRESENT IN PANEL
 CPU AND OUTLET POWERED VIA A UPS LOCATED BELOW THE COMPUTER MONITORS
 IN THE PITTAG ROOM

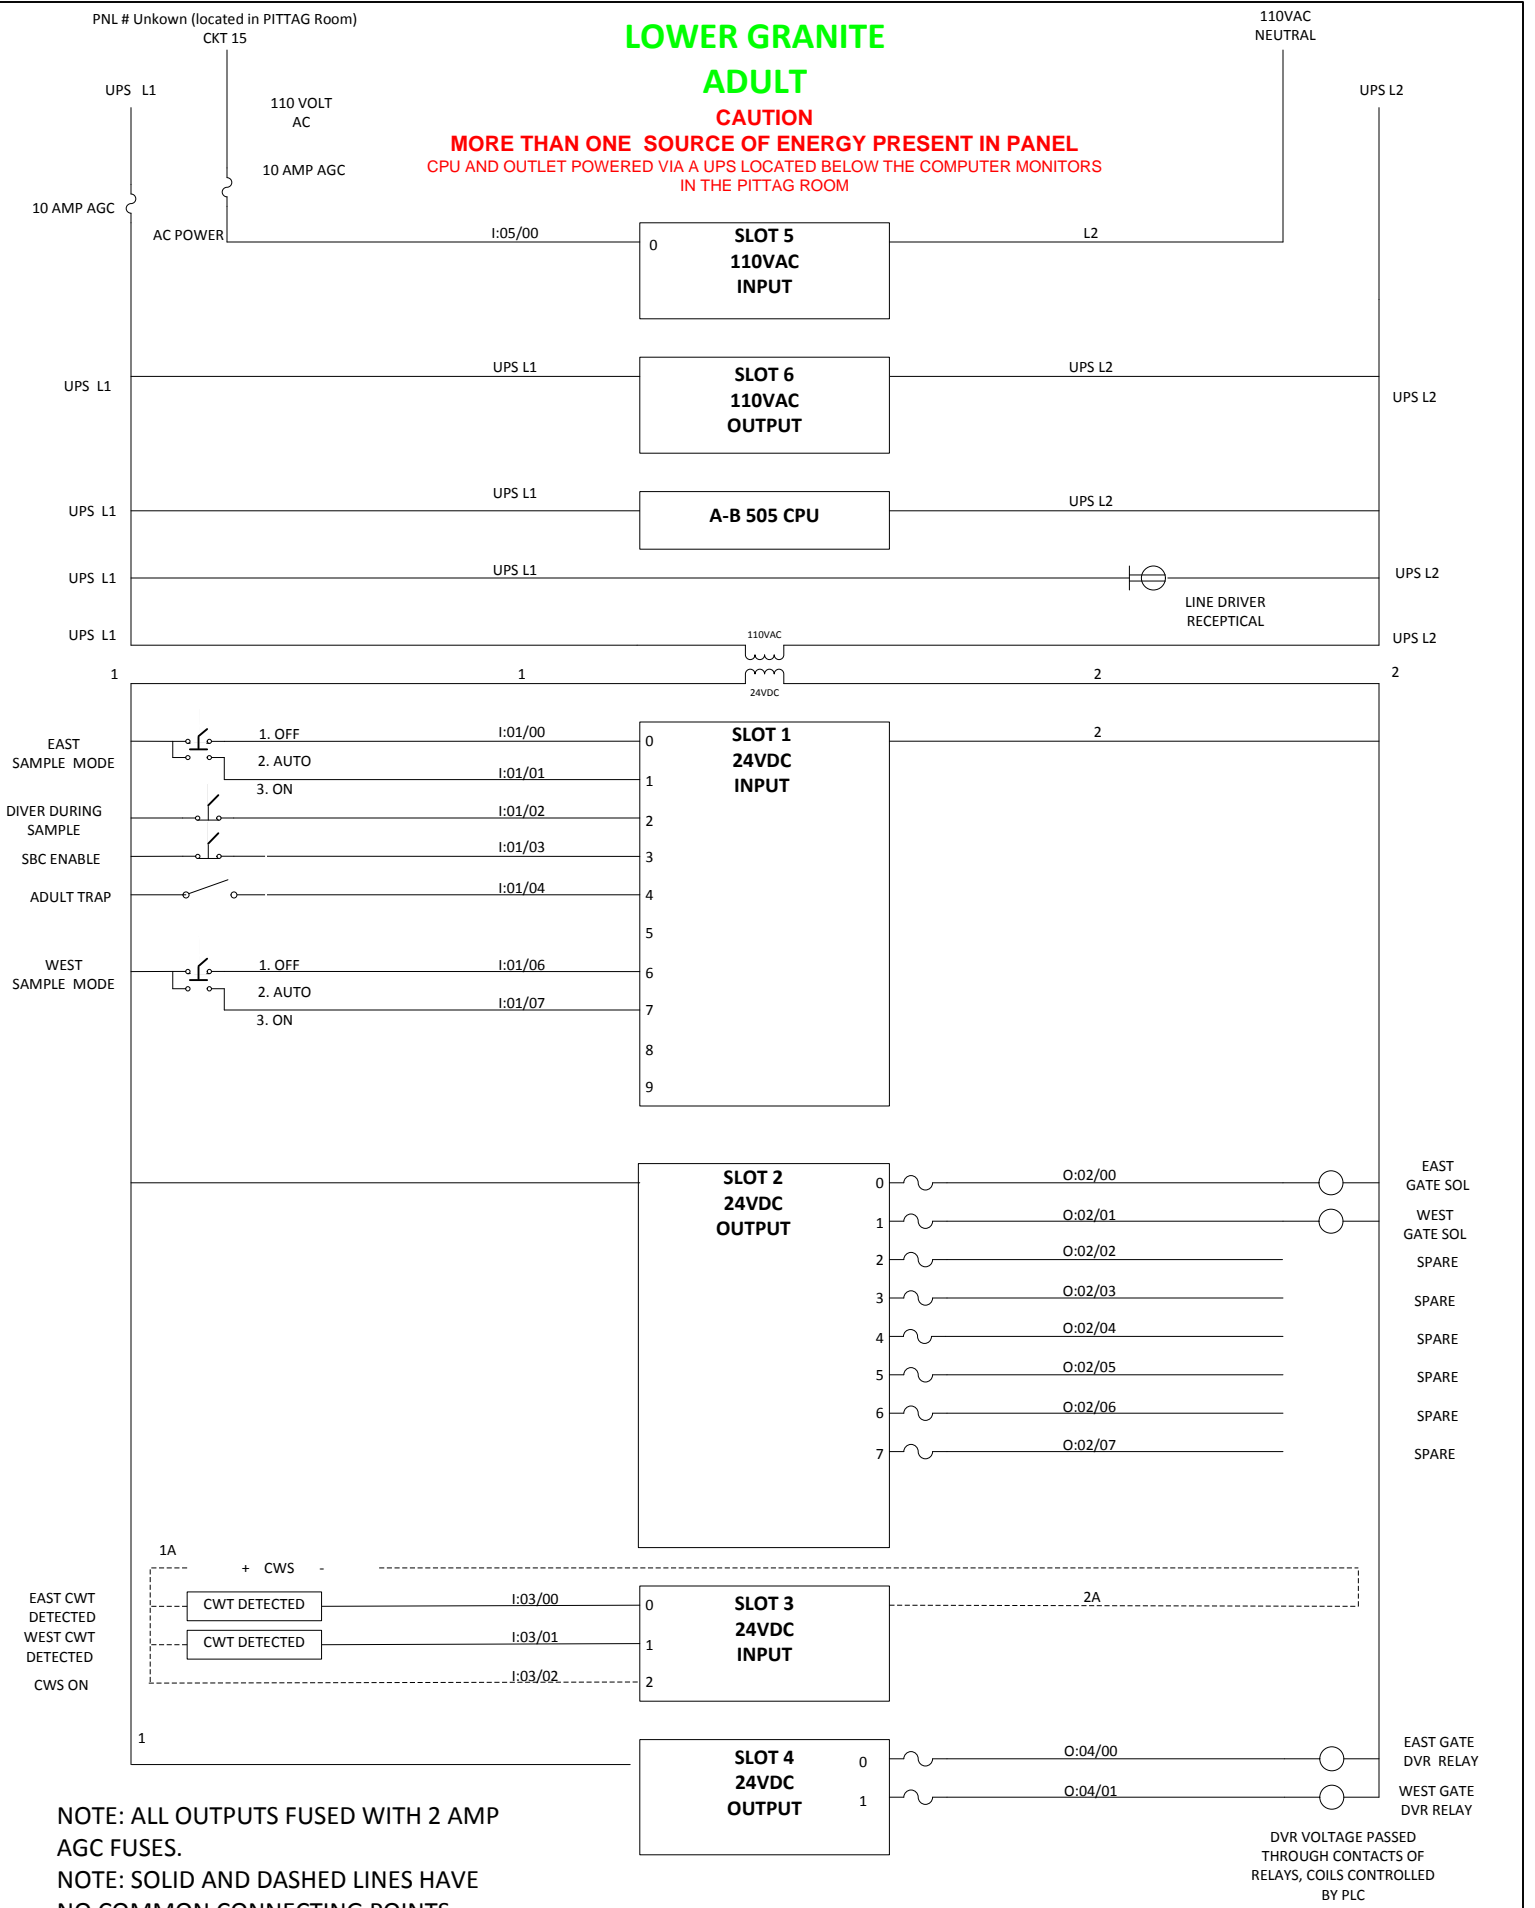

NOTE: ALL OUTPUTS FUSED WITH 2 AMP AGC FUSES.

NOTE: SOLID AND DASHED LINES HAVE NO COMMON CONNECTING POINTS
 .DASHED LINES INDICATE CWS POWERED LINES.

NAME: GRA	
REV 1	DRAWN BY: TNH
03/04/11	PSMFC

DVR VOLTAGE PASSED THROUGH CONTACTS OF RELAYS, COILS CONTROLLED BY PLC