


MCNARY

110 VOLT AC

110VAC NEUTRAL

CAUTION

MORE THAN ONE SOURCE OF ENERGY PRESENT IN PANEL
 CPU AND OUTLET POWERED VIA A UPS LOCATED BELOW THE COMPUTER MONITORS
 IN THE PITTAG ROOM

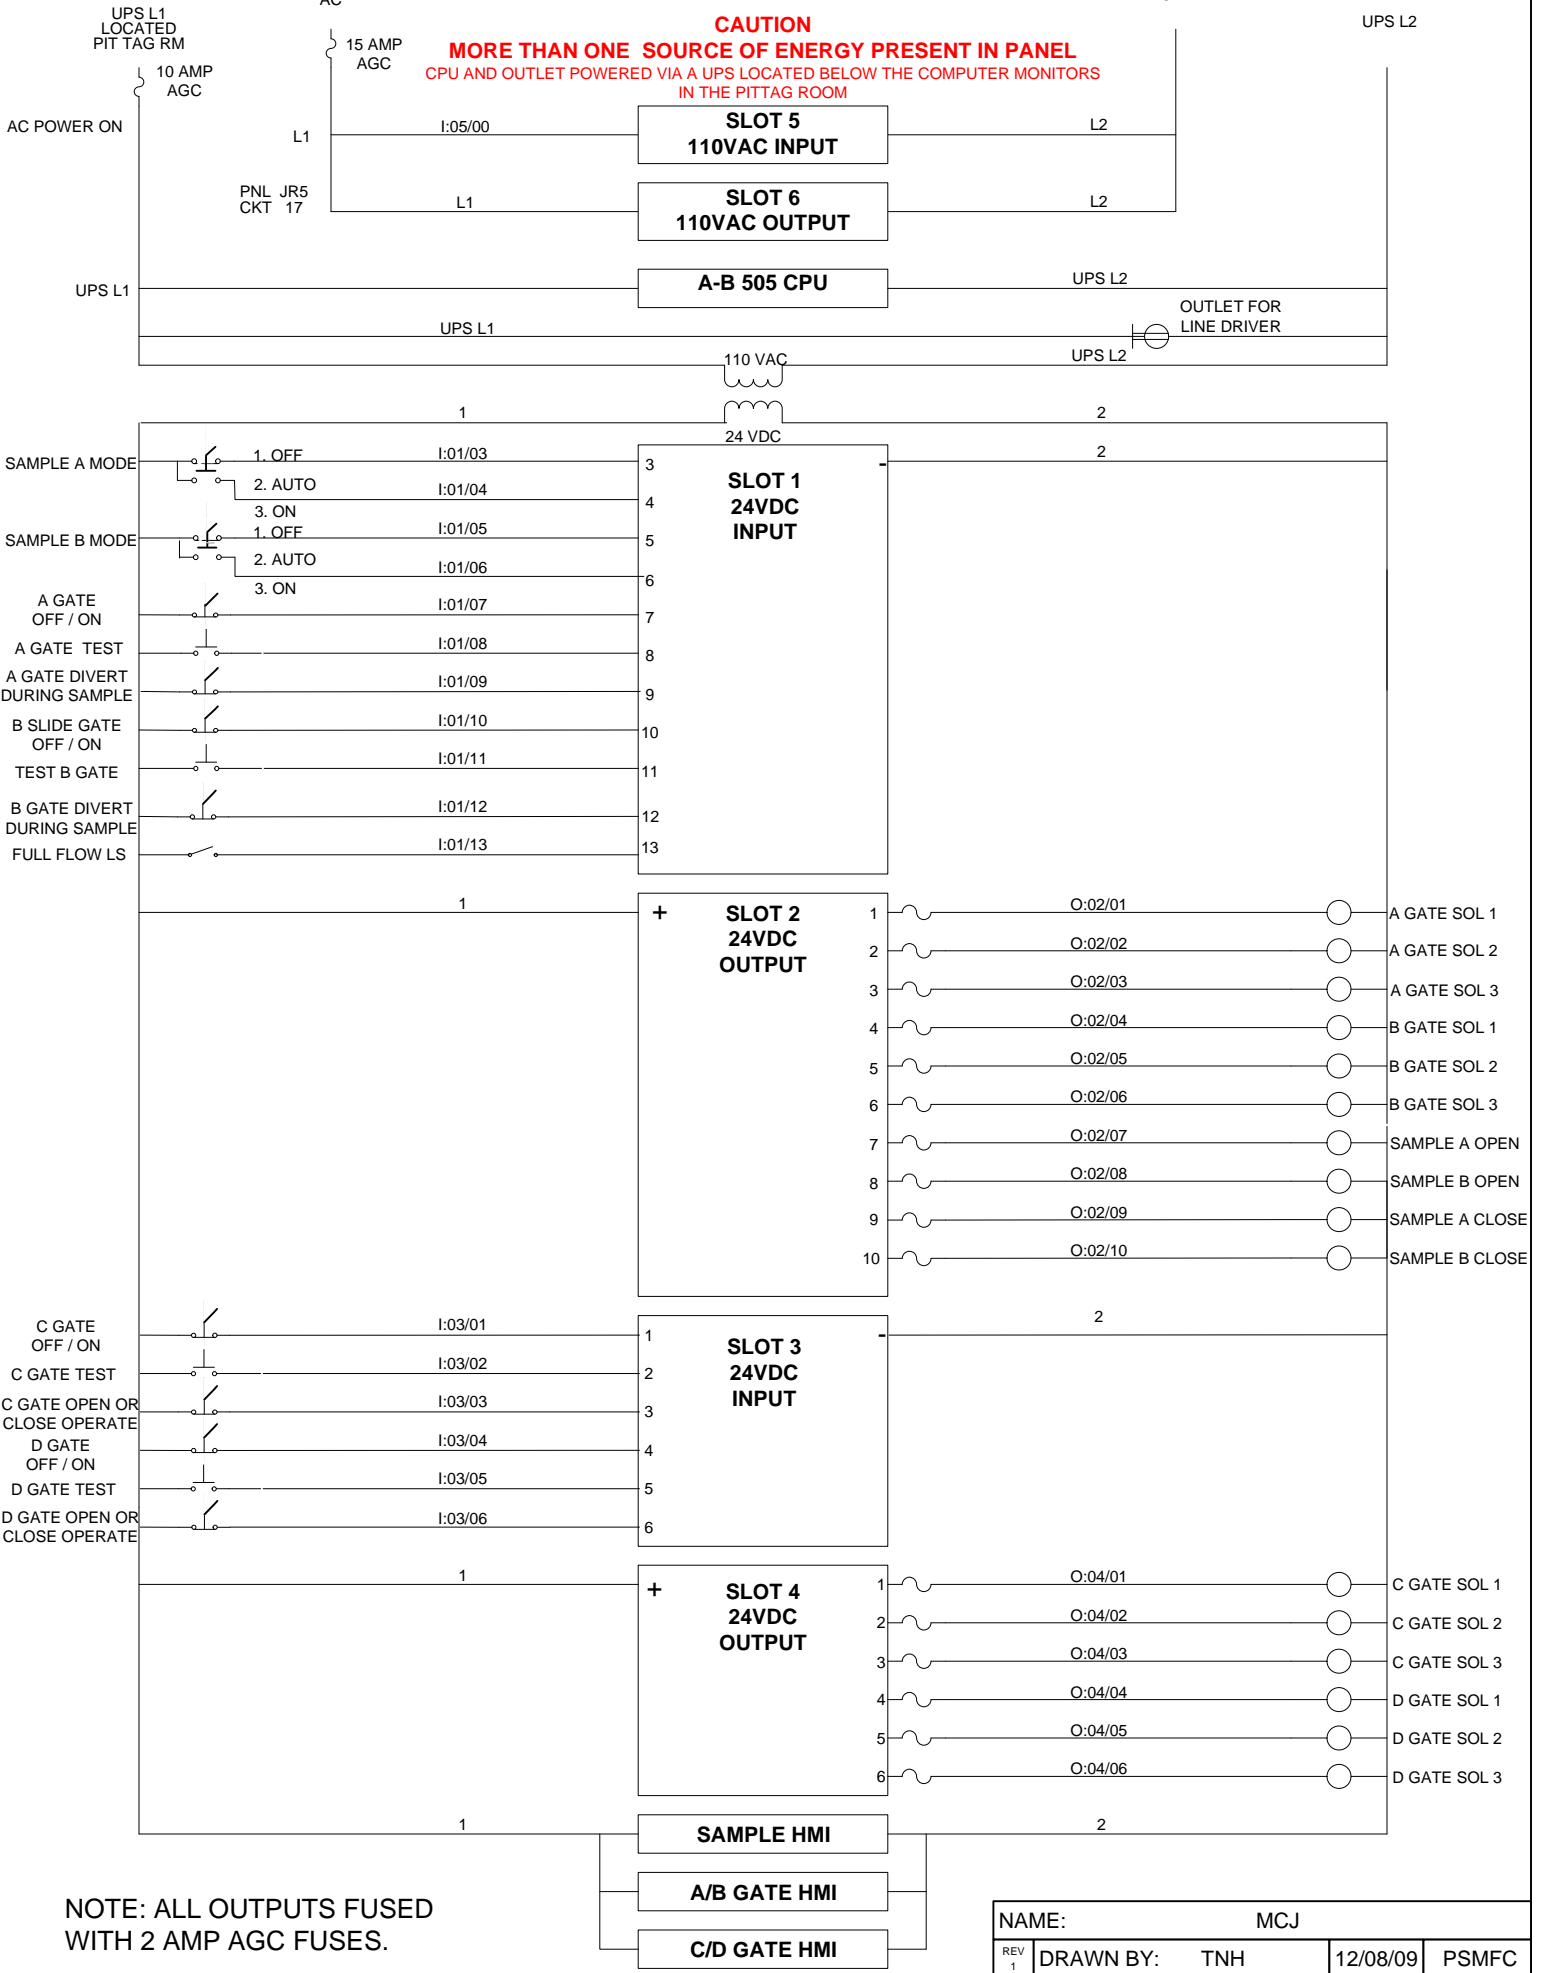

NOTE: ALL OUTPUTS FUSED WITH 2 AMP AGC FUSES.

NAME: MCJ	
REV 1	DRAWN BY: TNH
12/08/09	PSMFC