
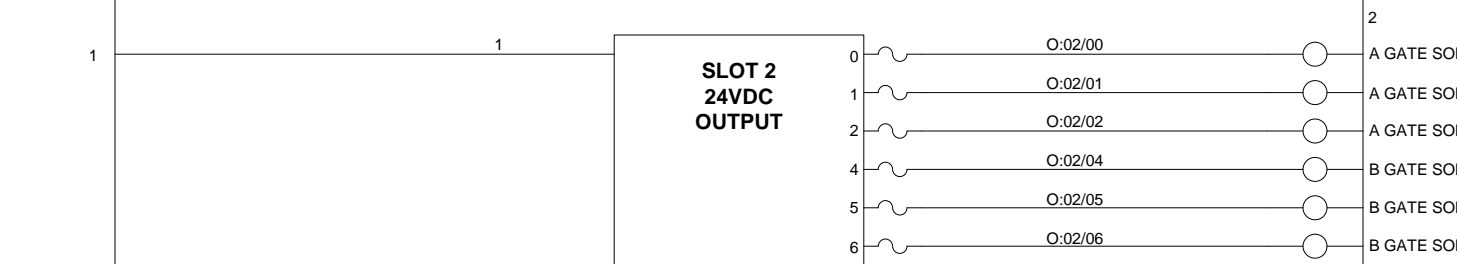
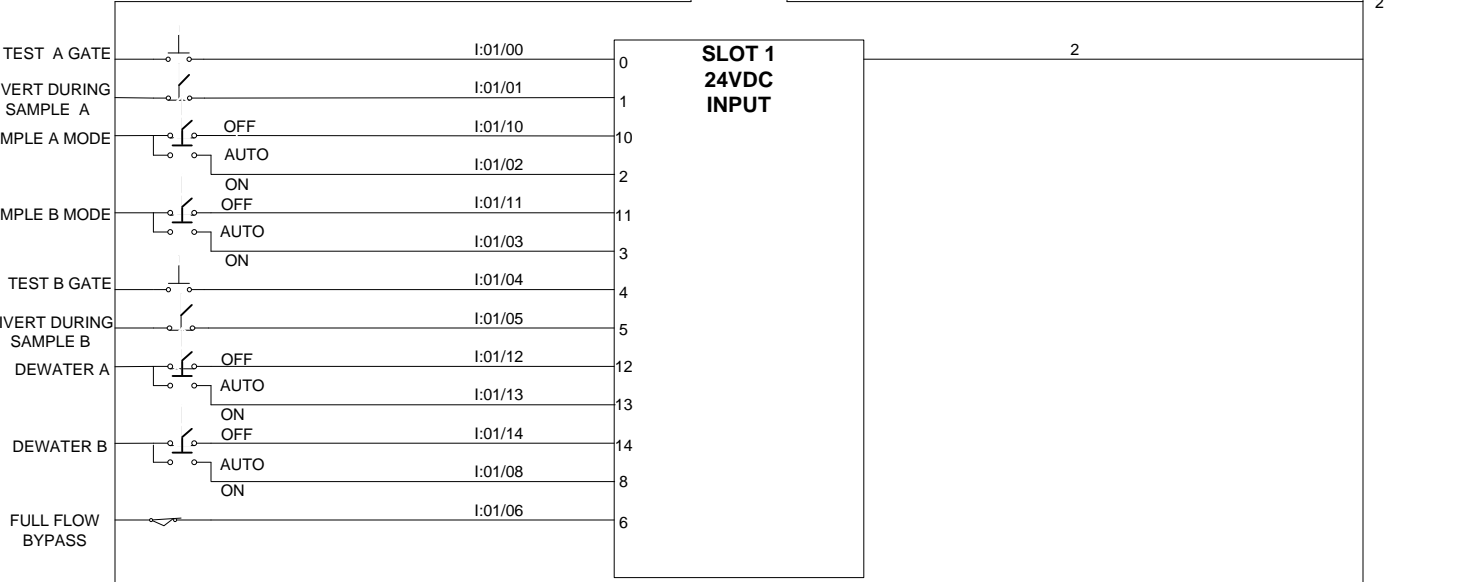



LOWER MONUMENTAL

CAUTION

MORE THAN ONE SOURCE OF ENERGY PRESENT IN PANEL
 CPU AND OUTLET POWERED VIA A UPS LOCATED BELOW THE COMPUTER MONITORS
 IN THE PITTAG ROOM

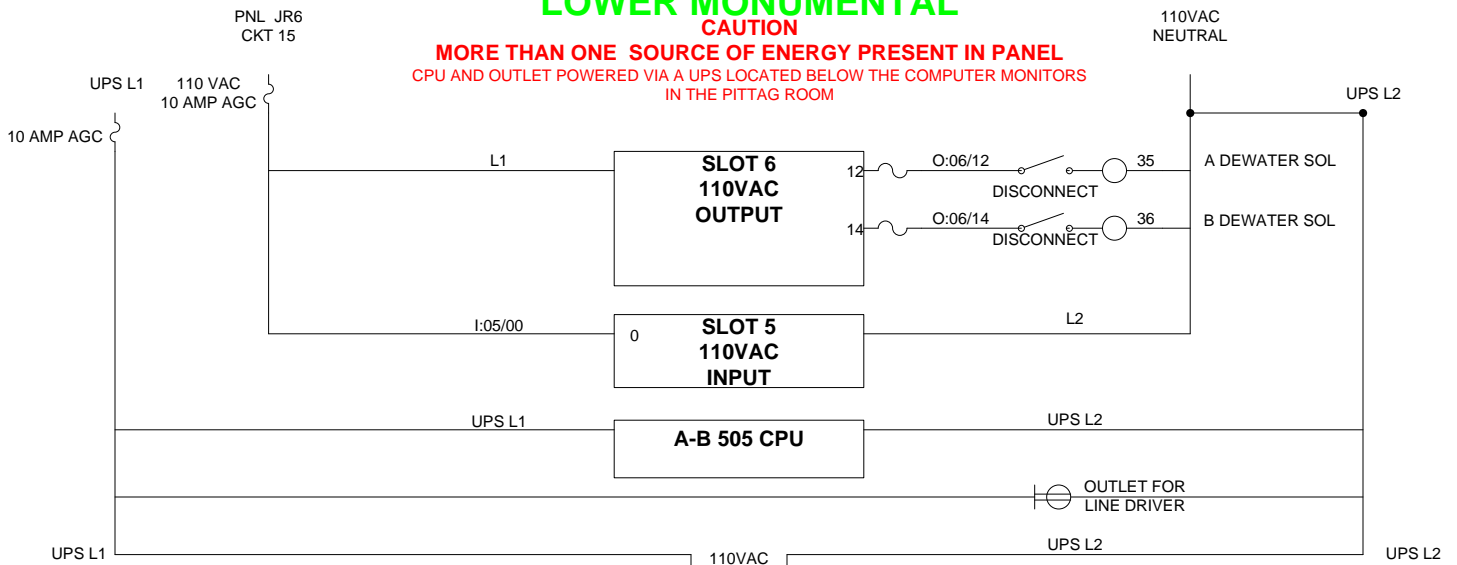

NOTE: ALL OUTPUTS FUSED WITH 2 AMP AGC FUSES.
NOTE: DISCONNECTS AT DEWATERING VALVES CONTAIN 30 AMP FUSES.

A
 CONTINUED ON PAGE 2


B
 CONTINUED ON PAGE 2

NAME: LMJ	
REV 1	DRAWN BY: TNH
01/21/10	PSMFC

LOWER MONUMENTAL PAGE 2

CONTINUED ON PAGE 1

CONTINUED ON PAGE 1

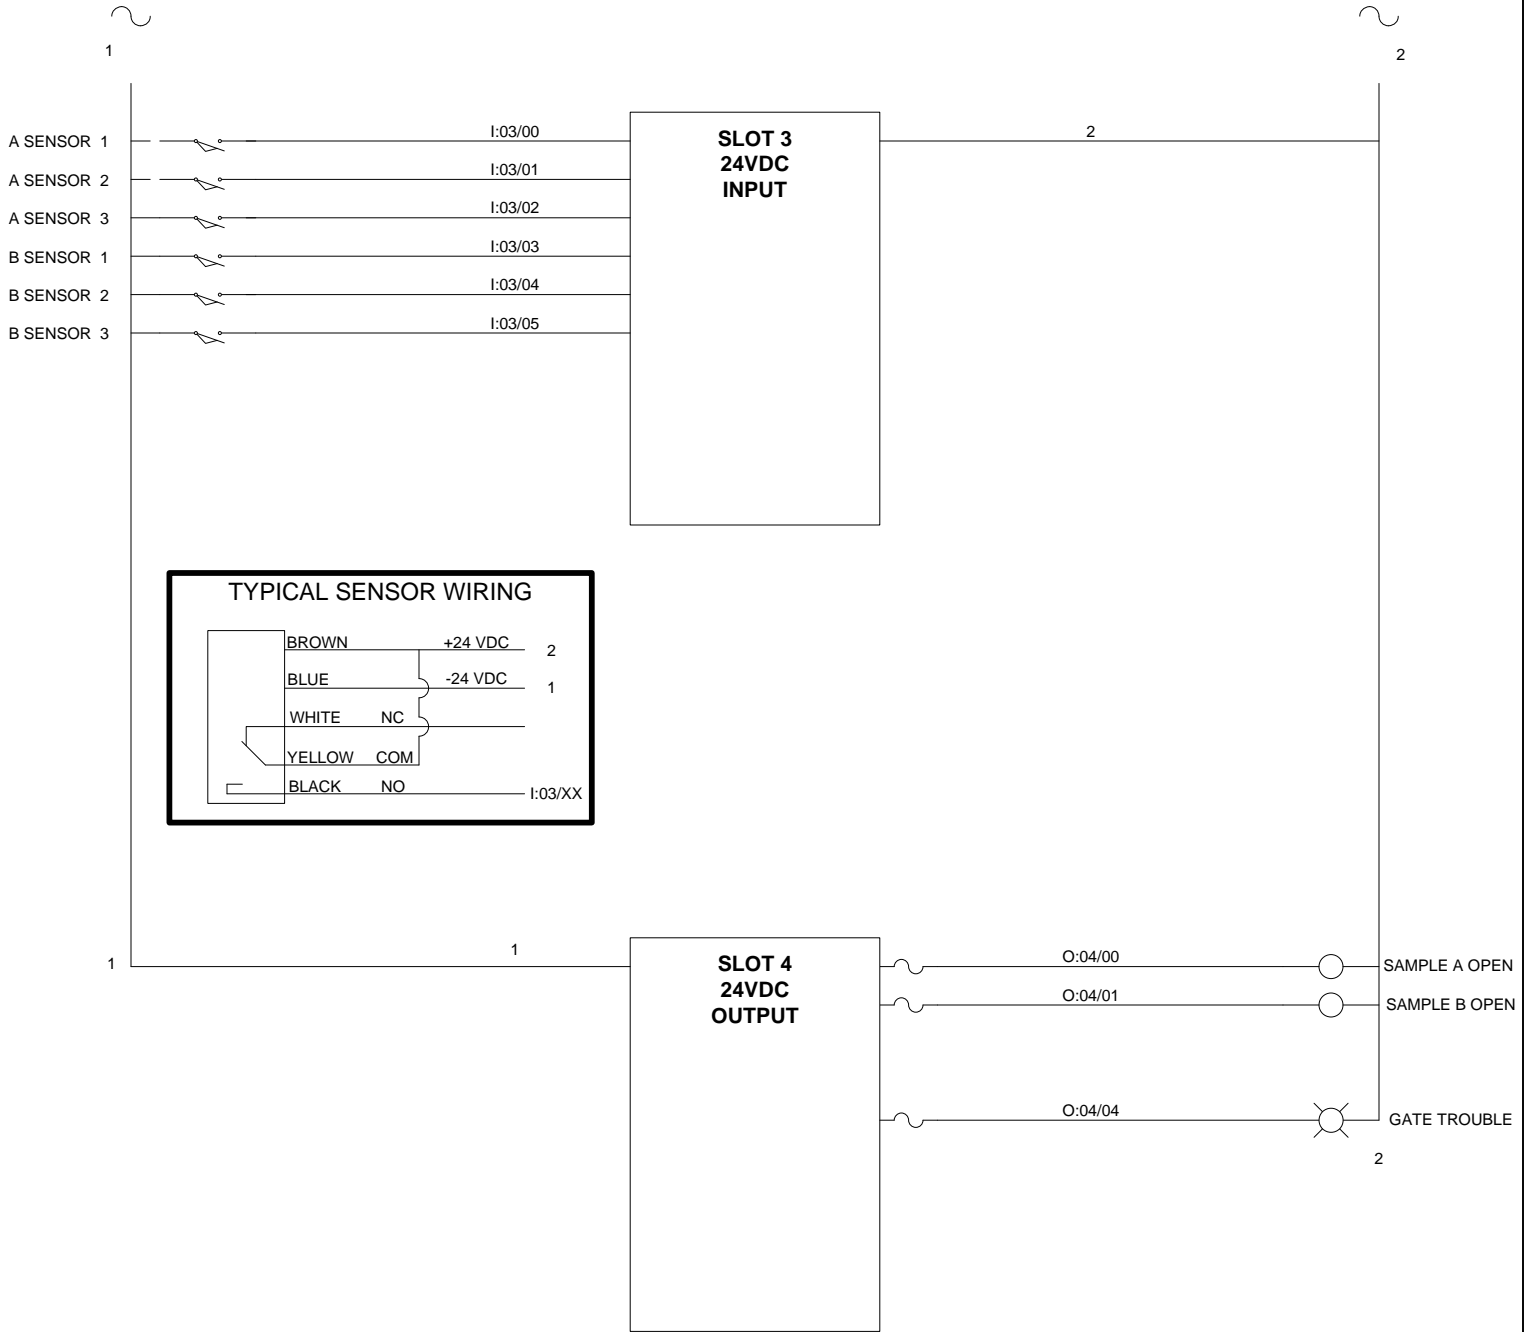

NAME:		LMJ	
REV 1	DRAWN BY:	TNH	01/21/10 PSMFC